


Project Management Initials: RL Designer: LC Checked: AR Approved: CC

Scale @ A3 1:40,000

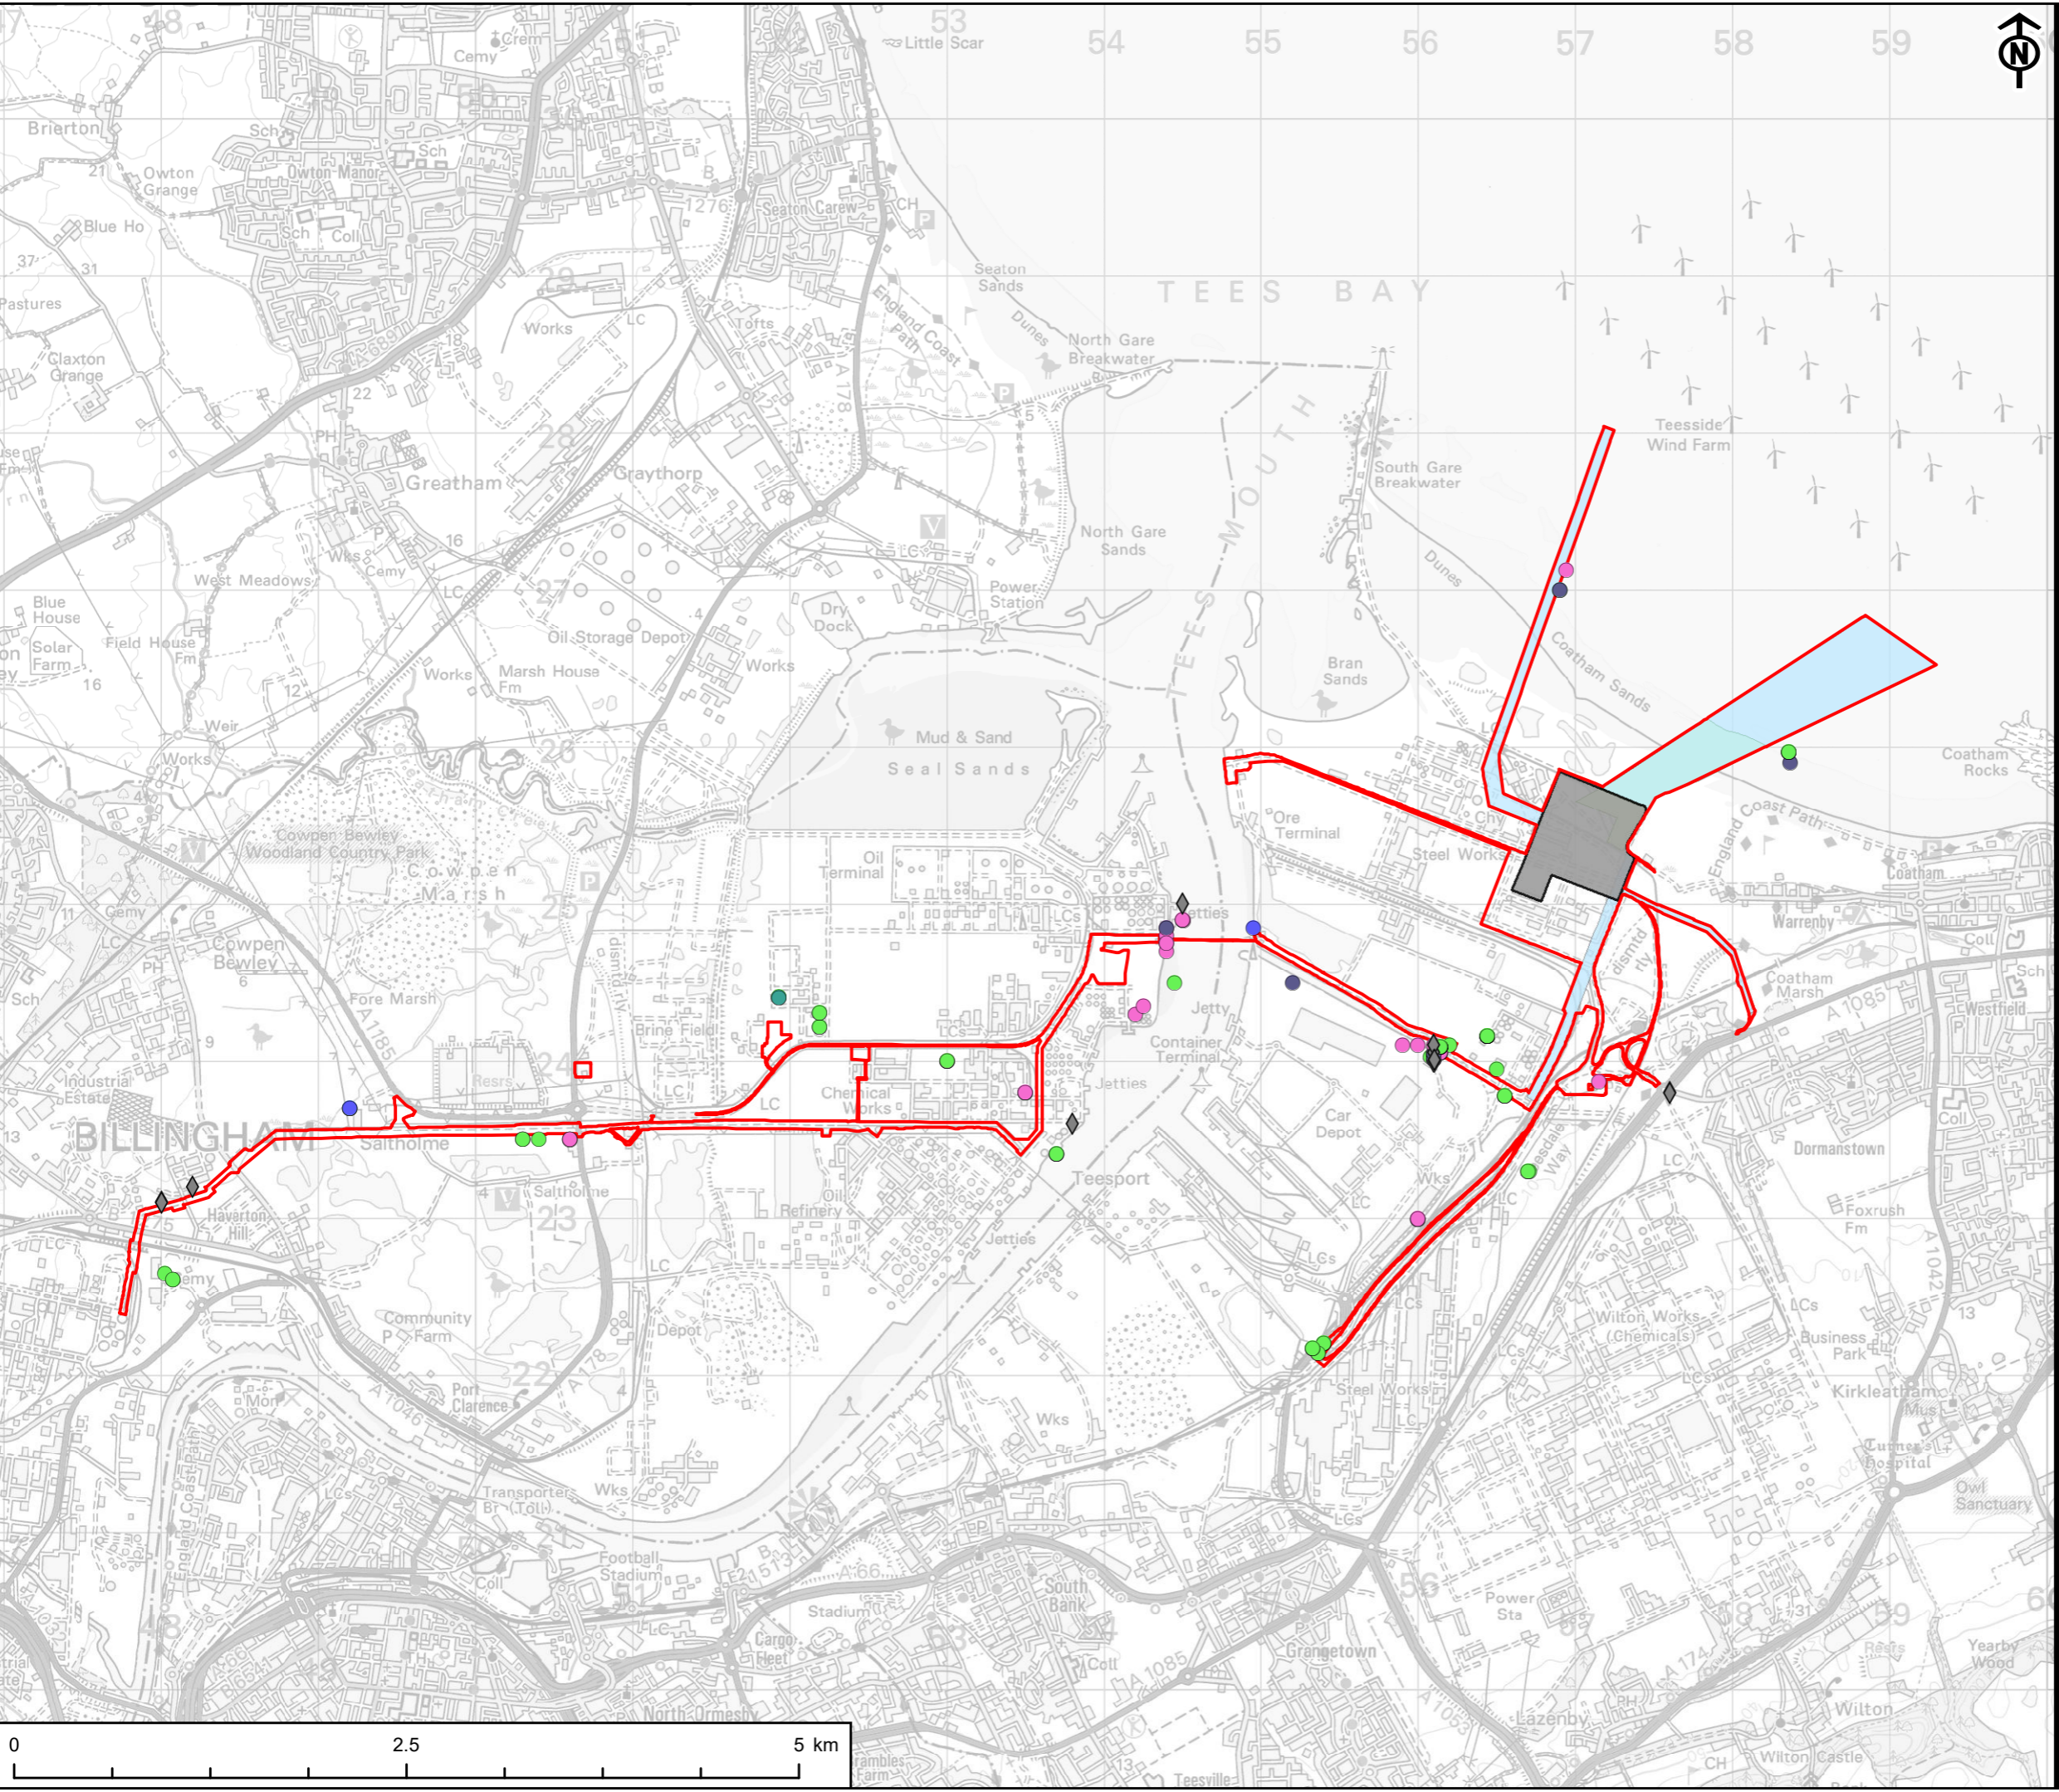


APPLICANTS
 NZT POWER LTD. AND NZNS STORAGE LTD.

- KEY**
- Site Boundary
 - Power, Capture and Compressor Site
 - Water Connection Corridors
 - CO₂ Export Pipeline
 - ◆ Pollution Incident to Controlled Waters
- Discharge Consent**
- Miscellaneous Discharge
 - Sewage Discharge
 - Sewerage Discharge
 - Trade Discharge
 - Unknown Discharge
 - Water Industry Discharge

TITLE
 FIGURE 10-15
 DISCHARGE

REFERENCE
 NZT_220912_ES_10-15_v3

SHEET NUMBER 1 of 1
DATE 12/09/2022



This drawing has been produced for the use of AECOM's client. It may not be used, modified or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies upon this drawing without AECOM's express written consent. All dimensions are indicative and in metres unless otherwise noted. Do not scale this document.